

DISABLED WC (FEH1001)


THIS SYSTEM SERVES DISABLED PEOPLE IN TOILETS AND OTHERS WHO NEED SERVICE IN PUBLIC BUILDINGS.

FUNCTION

WHEN ONE PUSHES THE CALLING BUTTON OR DRAWS THE CORD, THE ALARM UNIT, WHICH IS OUTSIDE ACTIVATES GIVING A FLICKERING LIGHT AND A BEEPING SOUND. THE CALLING BUTTON INCLUDES A LED INDICATING THAT THE ALARM WAS GIVEN. THE ALARM IS ACTIVE UNTIL IT IS CANCELLED FROM THE CANCELING BUTTON OF THE CONTROL UNIT. THE BUZZER OF THE ALARM UNIT COULD BE DEACTIVATED WHEN NEEDED. THE CALLING BUTTON HAS THE FOLLOWING ADDRESS MODES:

FUNCTION A: IN ALARM MODE THE LED LIT IN ALL PUSH BUTTONS.

FUNCTION B: IN ALARM MODE THE LED LIT ONLY IN THE PUSH BUTTON WHICH HAS BEEN PUSHED.

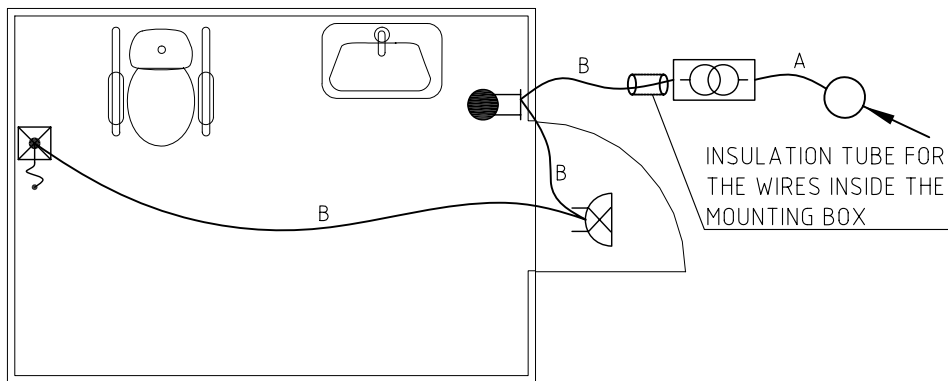

CABLING EXAMBLER

A = E.G. MMJ 2x1,5N

B = E.G. MHS 1 x 4 x 0,5
KLM 4 x 0,8
KLMA 4 x 0,8 + 0,8



DRAW CORD BUTTON
FAP3002

- THE CORD IS CUT TO A SUITABLE LENGTH



ALARM UNIT
FIM 1200

- INSTALLED ABOVE THE WC DOOR



CONTROL UNIT
FEH 1001

- INSTALLED INSIDE THE TOILET BESIDE THE DOOR,
INCL. CANCELING BUTTON



TRANSFORMER 230V/15V/2VA
FLM 1000

- TO BE INSTALLED IN OWN MOUNTING BOX



ABB
Porvoon Sisäkehä 2, P.O.Box 16
06101 Porvoo, Finland
Tel. 010 22 11
Fax. 010 22 54255
www.abb.com

SPECIAL FEATURES OF THE SYSTEMS:

CONSTRUCTIONS OBJECT:

CONTENTS OF DRAWING:

DISABLED WC (FEH1001)
WIRING DIAGRAM

DOK

DESIGN OFFICE:

DESIGNER:

WORK NO:

DATE:


DRAWER:

DRAWING NO:

DESIGN:

INSPECTOR:

DISABLED WC (FEH1001)

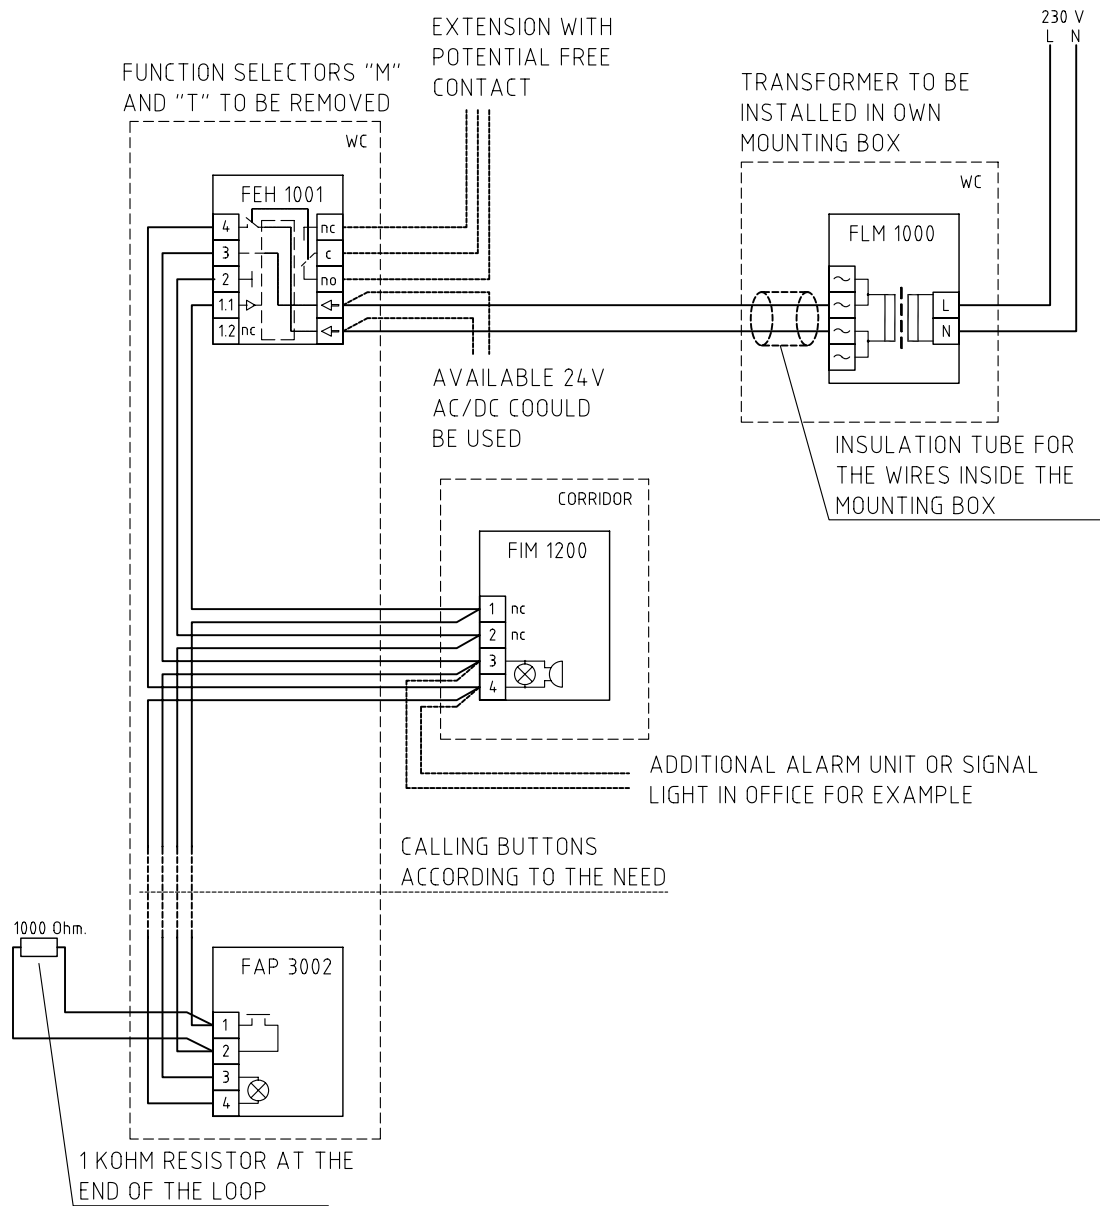

NOTE ! WHEN NEEDED THE SUPPLY CIRCUIT INCLUDES A SWITCH WHICH DISCONNECTS ALL TERMINALS. THIS SWITCH MUST BE INSTALLED IN A PLACE WHERE UNINTENTIONAL USE IS PREVENTED



ABB
Porvoon Sisäkehä 2, P.O.Box 16
06101 Porvoo, Finland
Tel. 010 22 11
Fax. 010 22 54255
www.abb.com

SPECIAL FEATURES OF THE SYSTEMS:

CONSTRUCTIONS OBJECT:

CONTENTS OF DRAWING:

DISABLED WC (FEH1001)
CONNECTION DIAGRAM

DOK

DESIGN OFFICE:

DESIGNER:

WORK NO:

DATE:

DRAWER:

DRAWING NO:

DESIGN:

INSPECTOR: